


TAPPING SLEEVE - Gate valve, resilient seated with fully encapsulated gate, epoxy-coated inside and outside, full-size waterway, open to the left, non-rising stem with O-ring seals, 200 psi working pressure, and meets AWWA C-509. AVK, CLOW 6100 or approved equal. New line and tapping sleeve must be at least one size smaller than the existing main.

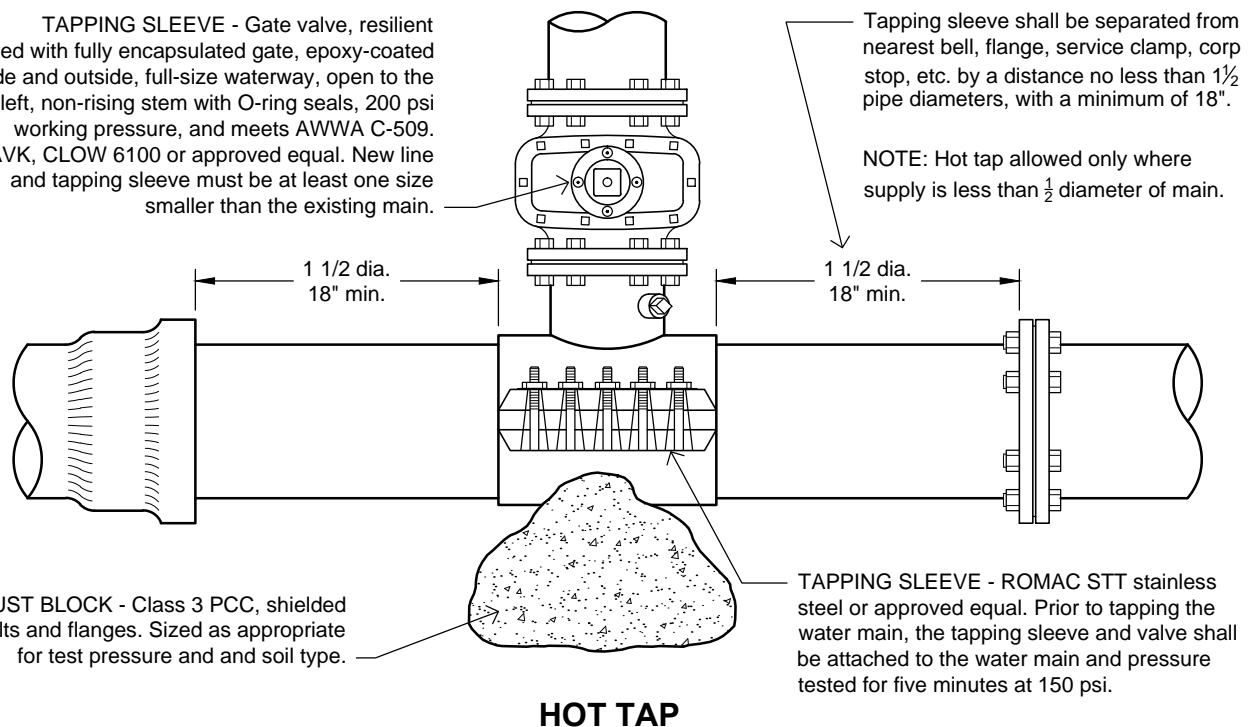

SCALE: N.T.S.

STANDARD CURRENT AS OF: 01/20/2020

APPROVED BY: XX

NOTES:



CAL POLY

WATERLINE SERVICE

6260