


½" x 18" smooth bars @ 18" O.C. in sidewalk, one each in curb and gutter, one end to be sleeved or greased. Use of speed dowels is an acceptable alternative.

**SIDEWALK SECTION**

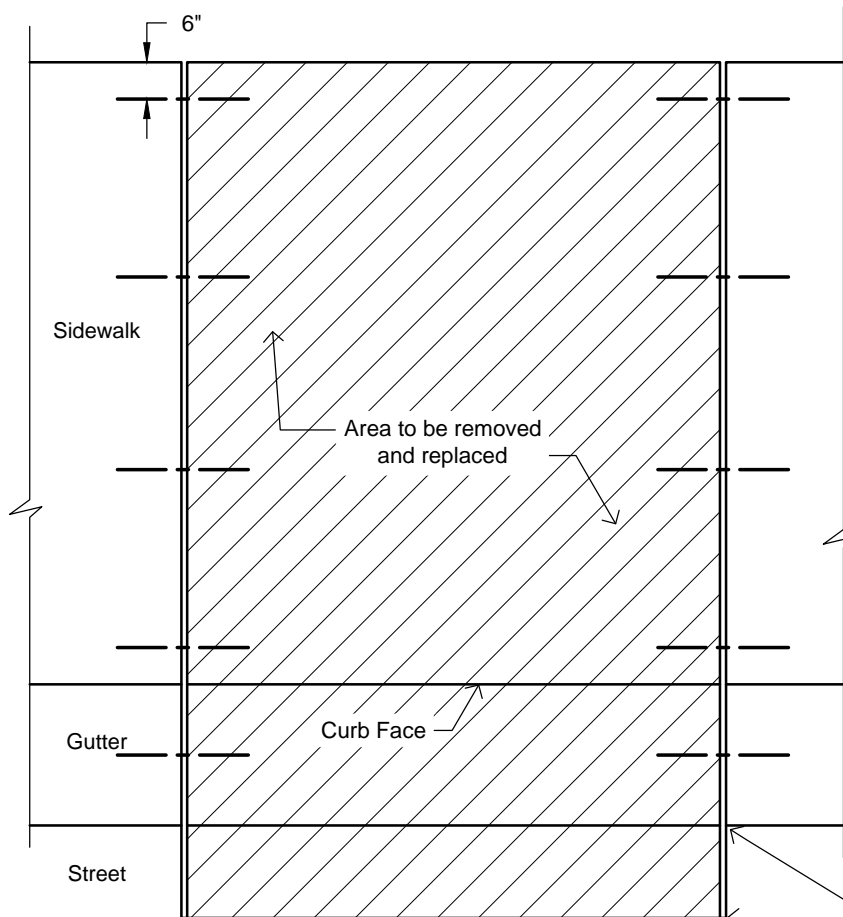

**NOTE:** Remove complete sections of curb, gutter and sidewalk to nearest control or expansion joint, unless otherwise approved by the University.

See Engineering Standard 4110 for notes regarding required pavement removal and repair.

**PLAN OF CURB, GUTTER & SIDEWALK**

SCALE: N.T.S.

STANDARD CURRENT AS OF: 10/19/2019

APPROVED BY: XX

NOTES:



CAL POLY

**CUTTING CONCRETE**

4910